


NPA'S REQUIREMENT FOR THE GRANT AND ISSUE OF PERMIT TO CONSTRUCT LPG FILLING PLANT

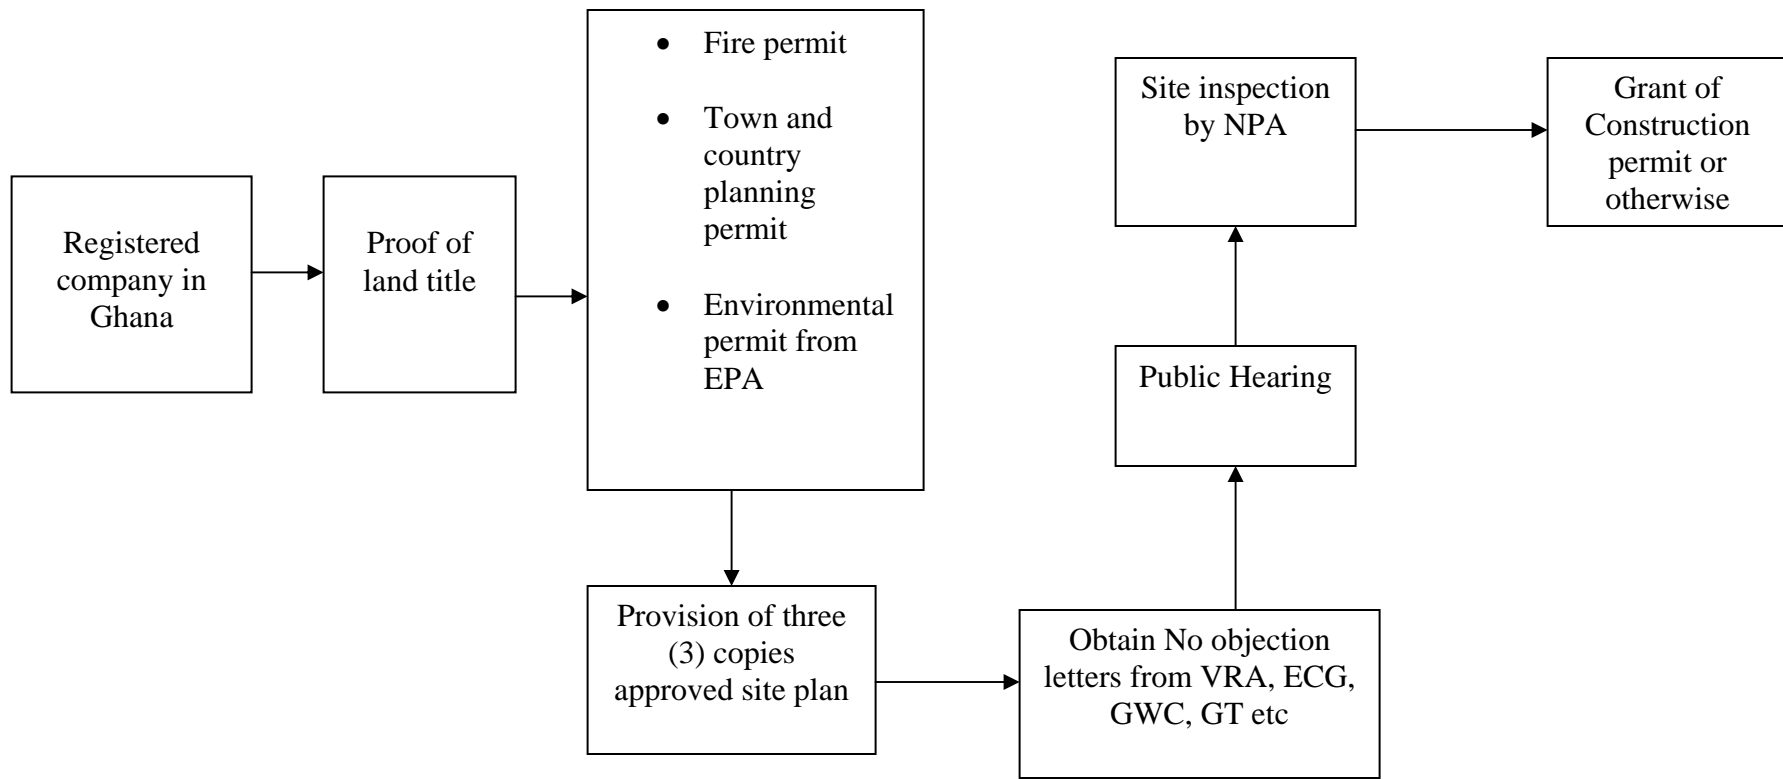

Note:

The required minimum plot size is 100ft by 180ft for storage tank with capacity of 40 tonnes.